



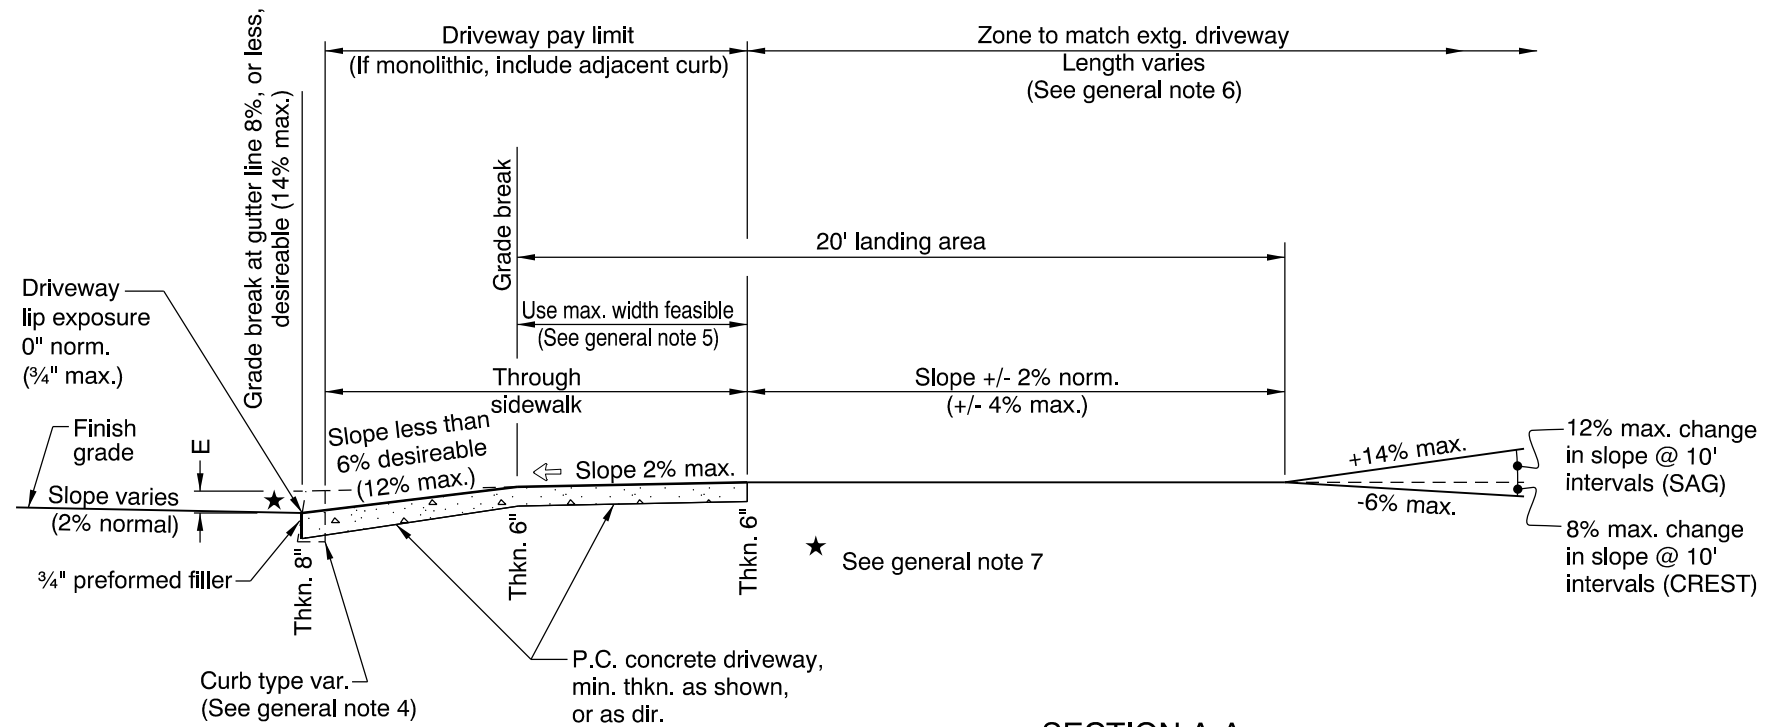

ALTERNATE SLOPE CONSTRUCTION DETAIL

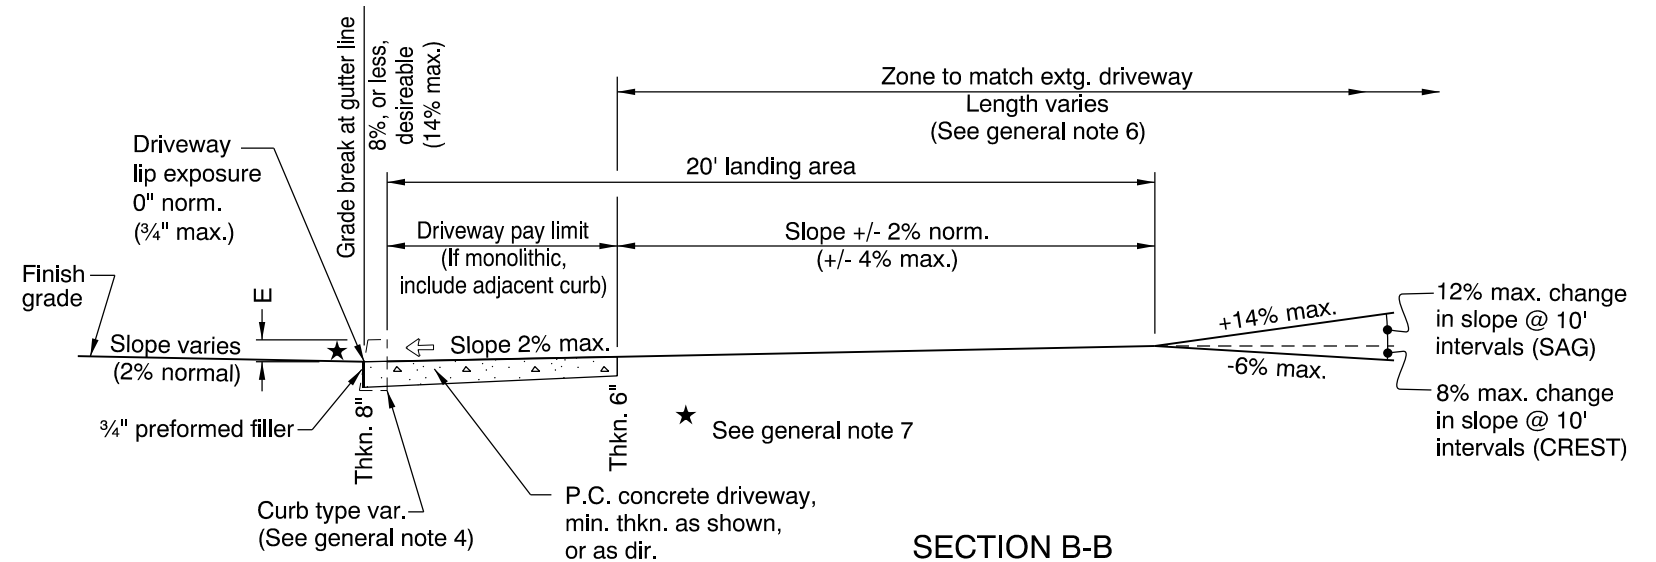

SECTION B-B

1. Details are based on United States Access Board Standards.
2. Only use details allowed by jurisdiction.
3. The following dimensions are as shown on plans, or as directed: driveway width, driveway slope, sidewalk width, curb exposure, driveway lip exposure, landing area length and width. See project plans for details not shown.
4. Curb, gutter, and sidewalk types varies, see plans.
See Std. Drgs. RD700 & RD701 for curb details.
See Std. Drg. RD720 for sidewalk details.
5. 4' unobstructed clear passage with slope of 2% max. is required behind driveway apron. 3.5' width is acceptable where sidewalk width is less than standard 6'.
6. Where existing driveway is in good condition, and meets slope requirements, construct only as much as required for satisfactory connection with new work.
7. Check the gutter flow depth at driveway locations to assure that the design flood does not overtop the back of sidewalk at driveway.
If overtopping occurs place an inlet at upstream side of driveway or perform other approved design mitigation.
8. Tooled joints are required at all driveway slope break lines.
9. 15' min. of the driveway behind the sidewalk should be surfaced to prevent tracking of gravel onto the sidewalk.
10. Monolithic curb & sidewalk shall retain thickened edge through lowered profile, to accommodate driveway use. See Std. Drg. RD720 for details.

	Sidewalk	CALC. BOOK NO. _____ N/A _____ <i>The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.</i>	BASELINE REPORT DATE _____ 12-JAN-2015 _____										
	Driveway pay limit (If monolithic, include adjacent curb)		NOTE: All material and workmanship shall be in accordance with the current Oregon Standard Specifications										
			OREGON STANDARD DRAWINGS										
			CURB LINE SIDEWALK DRIVEWAYS OR ALLEYS (OPTIONS F & G) ODOT HIGHWAYS										
			2015										
	Slope 2% max. (Normal sidewalk cross slope)												
	Slope 8.33% (1":12") max. (Ramp length 15' max.)												
W	Width of driveway												
E	Curb exposure												
		<table><tr><th>DATE</th><th>REVISION DESCRIPTION</th></tr><tr><td>01-2015</td><td>REVISED NOTES</td></tr><tr><td></td><td></td></tr><tr><td></td><td></td></tr><tr><td></td><td></td></tr></table>		DATE	REVISION DESCRIPTION	01-2015	REVISED NOTES						
DATE	REVISION DESCRIPTION												
01-2015	REVISED NOTES												